



PRODUZIONE ESTINTORI D'INCENDIO OMOLOGATI E CERTIFICATI
PRODUCTION OF APPROVED FIRE EXTINGUISHERS

www.emme-italia.com



Data Sheet

Code 21063-71 Kg 6 Powder Fire Extinguisher UNI EN 3-7
Fire Rating 34 A 233 B C



Features

- Manufactured in accordance with and tested EN 3-7
- CE Marked according to Directive PED 2014/68/EU
- *Quality Product* certification guaranteed by Bureau Veritas Italia
- Permanent pressure with N2 or dehumidified air
- High quality pressure gauge
- Made in Italy CPF valve
- Powder EPW 18462

The powder is not conductive and the fire extinguisher may be used in presence of electric equipment up to 1000V.

ABC Powder is ideal for Class A fires (solid combustibles), Class B fires (flammable liquids) and Class C fires (flammable gases).

- Manufactured in Italy

CPF
INDUSTRIALE

ESTINTORE APPROVATO EN3/7
Test Report No. 20140914



Accreditation DIN EN
ISO/IEC 17020:2012



File Name	Code	Date	Rele.	Chek	Rev.	Pag.
Ds_21063-71	21063-71	15/06/2017	D.P.	D.P.	0	1/2

EMME ANTINCENDIO S.r.l

Factory: Via del Molino, 40 - 52010 Corsalene (AR) - Italy - Tel. +39.0575.511320
Warehouse: Via G. Di Vittorio, 11 - 20017 Mazzo di Rho (MI) - Italy - Tel. +39.0293900399
E-mail: info@emme-italia.com - milano@emme-italia.com - web site: www.emme-italia.com
P.IVA/ C.F. 11208251006 - R.E.A. FI-632545



PRODUZIONE ESTINTORI D'INCENDIO OMOLOGATI E CERTIFICATI
PRODUCTION OF APPROVED FIRE EXTINGUISHERS

www.emme-italia.com



Technical Specifications


Model UNI EN 3-7	<i>cod. 21063-71</i>
Nominal Charge	<i>6 kg</i>
Fire Rating	<i>34 A 233 B C</i>
Temperature Range	<i>-30°C + 60°C</i>
Extinguishing Agent	<i>Powder EPW 18462</i>
Working Pressure	<i>Dehumidified Air or N2</i> <i>14 Bar a 20°C</i>
Discharge Time	<i>16 sec.</i>
Valve Tightening	<i>50 N</i>
Discharge Range	<i>3 m</i>
Cylinder Pressure Test	<i>PT 27 Bar</i>
Cylinder Bursting Pressure	<i>>55 Bar</i>
Cylinder Volume	<i>L 7.3</i>
Safety Valve	<i>20 - 24 Bar</i>
Cylinder Material	<i>Carbon Steel DC 04</i>
External Treatment	<i>Sandblast, epoxypolyestere</i> <i>coating red RAL 3000</i>

Dimensions

Height	<i>520 mm</i>
Diameter	<i>160 mm</i>
Weight	<i>Kg 9.5</i>

Packaging

1 Piece	N°44 Pieces
	Max 2 boxes for pallet

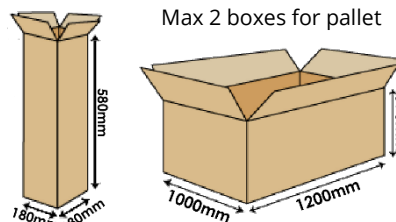

Installation


Do not expose the fire extinguisher to direct sunlight.
A protective Pvc cover is recommended when installed in marine and off-shore environments.

Spare Parts List

Pos.	Description	Code
1	Cylinder	1848K
5	Valve	0212C
7	Pressure Gauge	0271
5	Safety Valve	0261C
8	Safety Pin	0282C
10	Hose	1858
16	Powder EPW 18462	18462

Optional

Cover pvc		Code 0401
Bracket	Iron	Code 0316
	Aisi 304	Code 1464

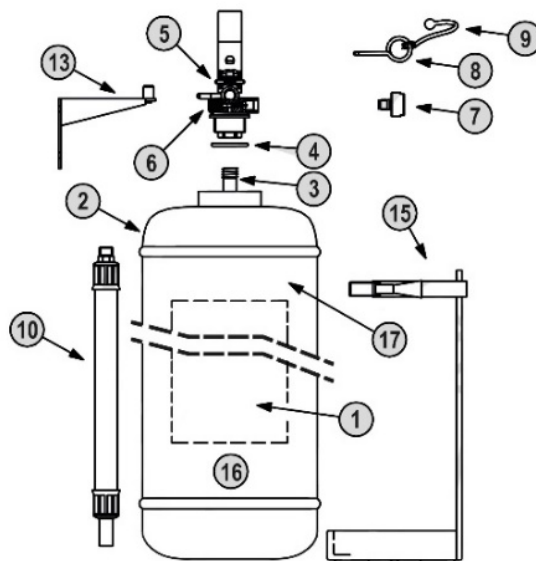

Maintenance

The extinguishers must be inspected and serviced by a TRAINED QUALIFIED PERSON in accordance with the local regulation concerning the inspections of the pressure equipment fire extinguishers. To ensure safe, trouble free performance and long life of the extinguishers, the manufacturer recommends the following: At least every two years replace the extinguishing agent; Inspect the cylinder and valve assembly for any external and internal damage or corrosion. Repair or replace all defective parts using only manufacturers supplied parts or refills; At least every 10 years from date of manufacture the extinguisher must be overhauled by means of an hydraulic pressure test at the pressure PT stamped on the cylinder, and submitted to a thorough inspection of the cylinder and valve should be made checking for any external or internal damage or corrosion. Any defective parts should be repaired or replaced using the specified parts mentioned in the spare part list.

File Name	Code	Date	Rele.	Chek	Rev.	Pag.
Ds_21063-71	21063-71	15/06/2017	D.P.	D.P.	0	2/2

EMME ANTINCENDIO S.r.l

Factory: Via del Molino, 40 - 52010 Corsalene (AR) - Italy - Tel. +39.0575.511320
Warehouse: Via G. Di Vittorio, 11 - 20017 Mazzo di Rho (MI) - Italy - Tel. +39.0293900399
E-mail: info@emme-italia.com - milano@emme-italia.com - web site: www.emme-italia.com
P.IVA/ C.F. 11208251006 - R.E.A. FI-632545