



PRODUZIONE ESTINTORI D'INCENDIO OMOLOGATI E CERTIFICATI
PRODUCTION OF APPROVED FIRE EXTINGUISHERS

www.emme-italia.com



Data Sheet

Codice 26010-1 Kg 1 Powder Fire Extinguisher UNI EN 3-7 Certificated RINA
Fire Rating 8 A 34 B C



Features

- Manufactured in accordance With and tested EN 3-7
- Certificated RINA
- CE Marked according to Directive PED 2014/68/EU
- Permanent stored-pressure through N2
- ABC Powder

It can be used on electrical equipment up to 1000 V voltage.

Suitable on class A fires (combustible materials), Class B fires (flammable liquids) and Class C fires (flammable gases)

File Name	Code	Date	Rele.	Chek	Rev.	Pag.
Ds_26010-1	26010-1	03/05/2017	D.P.		0	1/2

EMME ANTINCENDIO S.r.l

Factory: Via del Molino, 40 - 52010 Corsalene (AR) - Italy - Tel. +39.0575.511320
Warehouse: Via G. Di Vittorio, 11 - 20017 Mazzo di Rho (MI) - Italy - Tel. +39.0293900399
E-mail: info@emme-italia.com - milano@emme-italia.com - web site: www.emme-italia.com
P.IVA/ C.F. 11208251006 - R.E.A. FI-632545



PRODUZIONE ESTINTORI D'INCENDIO OMOLOGATI E CERTIFICATI
PRODUCTION OF APPROVED FIRE EXTINGUISHERS

www.emme-italia.com



Technical Specifications


Model UNI EN 3-7 Rina	<i>cod. 26010-1</i>
Nominal Charge	<i>1 kg</i>
Fire Rating	<i>8 A 34 B C</i>
Temperature Range	<i>-30°C + 60°C</i>
Extinguishing Agent	<i>ABC Powder</i>
Working Pressure	<i>N2</i>
	<i>12 Bar a 20°C</i>
Discharge Time	<i>9 sec.</i>
Valve Tightening	<i>50 N</i>
Discharge Range	<i>3 m</i>
Cylinder Pressure Test	<i>PT 25 Bar</i>
Cylinder Bursting Pressure	<i>>55 Bar</i>
Cylinder Volume	<i>L 1.05</i>
Cylinder Material	<i>Carbon Steel DC 04</i>
External Treatment	<i>Sandblast, epoxypolyestere coating red RAL 3000</i>

Dimensions

Height	<i>297 mm</i>
Diameter	<i>86 mm</i>
Weight	<i>Kg 1,7 Kg</i>

Packaging

6 Pieces each box.




Installation

Do not expose the fire extinguisher to direct sunlight.
A protective Pvc cover is recommended when installed in marine and off-shore environments.

Spare Parts List

Pos.	Description	Code
1	Safety Pin	-
2	Valve	-
3	Cylinder	-
4	Dip Tube	-
5	ABC Powder	-

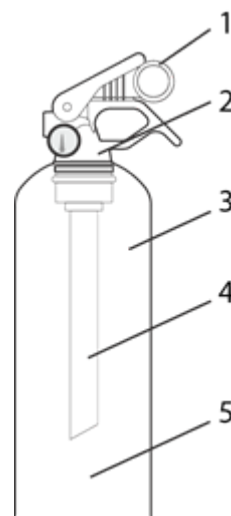

Maintenance

The extinguishers must be inspected and serviced by a TRAINED QUALIFIED PERSON in accordance with the local regulation concerning the inspections of the pressure equipment fire extinguishers. To ensure safe, trouble free performance and long life of the extinguishers, the manufacturer recommends the following: At least every two years replace the extinguishing agent; Inspect the cylinder and valve assembly for any external and internal damage or corrosion. Repair or replace all defective parts using only manufacturers supplied parts or refills; At least every 10 years from date of manufacture the extinguisher must be overhauled by means of an hydraulic pressure test at the pressure PT stamped on the cylinder, and submitted to a thorough inspection of the cylinder and valve should be made checking for any external or internal damage or corrosion. Any defective parts should be repaired or replaced using the specified parts mentioned in the spare part list.

File Name	Code	Date	Rele.	Chek	Rev.	Pag.
Ds_26010-1	26010-1	03/05/2017	D.P.		0	2/2

EMME ANTINCENDIO S.r.l

Factory: Via del Molino, 40 - 52010 Corsalene (AR) - Italy - Tel. +39.0575.511320
Warehouse: Via G. Di Vittorio, 11 - 20017 Mazzo di Rho (MI) - Italy - Tel. +39.0293900399
E-mail: info@emme-italia.com - milano@emme-italia.com - web site: www.emme-italia.com
P.IVA/ C.F. 11208251006 - R.E.A. FI-632545