

Technical Manual

EMME

ANTINCENDIO

SAFETY
FOR
FUTURE



www.emme-italia.com

Via del Molino, 40 - 52010 Corsalone (AR) - Italy - info@emme-italia.com - Tel. +39.0575.511320
P.IVA/ C.F. 11208251006 - R.E.A. AR-159122

22066-915 : Portable Fire Extinguisher, 6 L Foam

TESTED SUCCESSFULLY ON LITHIUM BATTERY WITH CAPACITY

36 V — 750 Wh — 20,1 Ah



CLIP DETAIL



AVAILABLE
CERTIFICATE
BENOR
EN3-B23/2304

FLUORINE FREE


- **CYLINDER**
In high-strength alloy steel, with clip, deep drawing, external powder painting Red Ral 3000.
- **EXTINGUISHING AGENT**
Lith-M FX. Fluorine free foam. Aqueous solution of carefully selected surfactants designed for use as foaming agents in a portable fire extinguisher.
- **PROPELLANT**
Dehumidified air or Nitrogen (N₂).
- **VALVE**
M. 30x1.5, brass body, levers with green painting Ral 6029.
- **USE**
Class A Fires (solid materials)
Class B Fires (flammable liquids)
Class F Fires (cooking oils)
Lithium-ion batteries

REPRODUCTION IS PROHIBITED

Note: image is for illustrative purpose only, the product purchased can has some difference

6 L foam fire extinguisher, temperature range from +5°C to +60°C, manufactured in accordance to **UNI EN 3-7 (D.M. 7.1.2005)**, approved Marine Equipment Directive **MED 2014/90/EU**, certified according to the directive for pressure equipment PED 2014/68/EU. Manufactured according to productions checks as agreed with **EN 3-10**. Quality Product certification guaranteed by Bureau Veritas Italia. Suitable for use on fire involving electrical voltages up to 1'000 V, at a minimum distance of 1 meter.

APPROVED/CERTIFIED FIRE EXTINGUISHER:



FIRE
RATING :



27



144



25



750 Wh

File name	Type of document	Fire Extinguisher Model	Date	Rele.	Check	Rev.	Pag.
22066-915_Technical manual	Technical manual	22066-915	28/05/2025	S.R		3	1/4

22066-915 : Portable Fire Extinguisher, 6 L Foam

• INSTALLATION

The installation must be carried out in accordance with the provisions in force in the country where the device is used.

• USE

The commissioning and maintenance activities for maintaining efficiency must be

• MAINTENANCE

carried out in accordance with the document **PSP_1-B_ENG** by qualified technical personnel and in compliance with the regulations in force in the country of use.

Any tampering or intervention carried out by unqualified personnel will void the product warranty.

It is recommended to place the device in a dry place protected from atmospheric agents.

TECHNICAL SPECIFICATIONS


FIRE RATING	27 A 144 B 25 F
EXTINGUISHING AGENT	Foam Lith-M FX
PROPELLANT	Dehumidified air or Nitrogen (N ₂), 15 Bar at 20°C
TEMPERATURE RANGE	+5°C / +60°C
NOMINAL CHARGE	6 Liters
FULL WEIGHT	~ 10,0 Kg
DIMENSIONS	Height (base - valve) 540 +/- 5 mm Diameter (cylinder) 160 +/- 2 mm
DISCHARGE TIME	~ 49,7 seconds
CYLINDER PRESSURE TEST	PT 27 bar
CYLINDER VOLUME	7,5 Liters
SAFETY DEVICE	Set between 20 and 26 bar
CYLINDER MATERIAL	Alloy steel
TREATMENT	Outside: Sandblast and powder painting Ral 3000 Inside: Plastic coating

PACKAGING

(Note: quantities and measurements are indicative and can be subject at changes)


STANDARD

Maximum nr. 100 pieces for pallet
(44 pieces for box, max 2 boxes for pallet)
(12 pieces. single packaging)
Pallet dimensions 100x120x160(h) cm

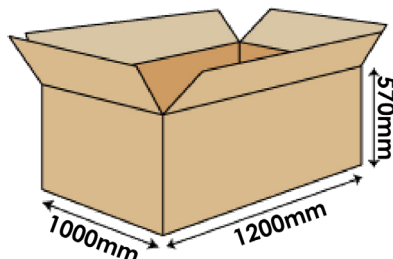

ON REQUEST: SINGLE PACKAGING

– maximum 64 pieces on pallet 100x120
– maximum 48 pieces on pallet 80x120

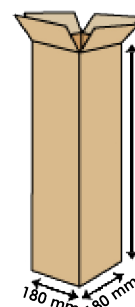

TRANSPORT DISPOSAL


Land transport : Exemption for the purposes of ADR disposal 594

Ship Transport : IMDG Code – UN 1044 class 2.2 Fire Extinguishers

File name	Type of document	Fire Extinguisher Model	Date	Rele.	Check	Rev.	Pag.
22066-915_Technical manual	Technical manual	22066-915	28/05/2025	S.R		3	2/4

22066-915 : Portable Fire Extinguisher, 6 L Foam

COMPONENTS AND SPARE PARTS LIST

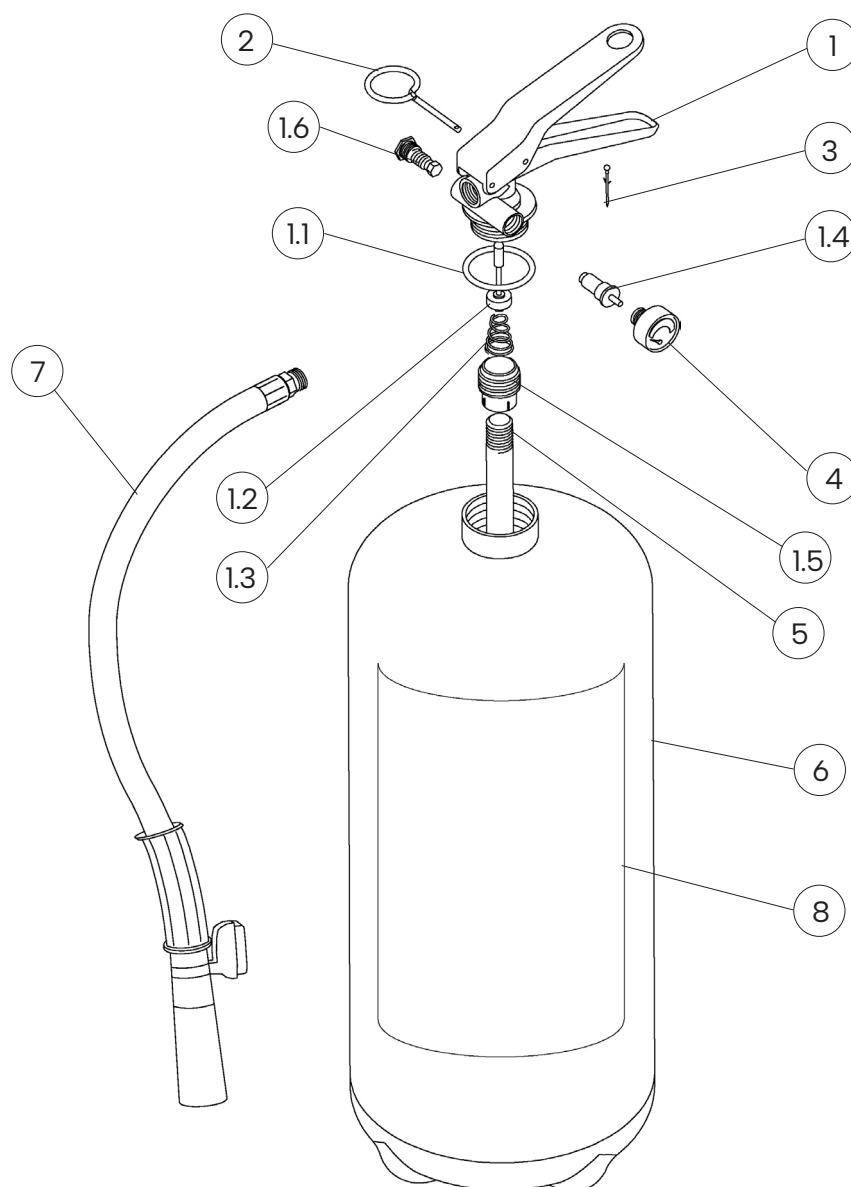

NUM.	DESCRIPTION	CODE	NUM.	DESCRIPTION	CODE
1	Valve M. 30x1.5	0212FV	5	PVC dip tube	0154
1.1	O-ring valve	0201R	6	Cylinder	0112-3
1.2	Valve stem	0242R	7	Hose with dispensing nozzle and magnet	0293-12
1.3	Internal spring of the valve	0251R	8	Label	0083-915
1.4	Test valve for pressure gauge	1163	OPTIONAL	Iron marine bracket red painting	0316
1.5	Dip tube holder	0253R	OPTIONAL	Stainless steel marine bracket	1464
1.6	Safety device	0261R	OPTIONAL	Wall-mounted bracket for fire extinguisher with clip	3036
2	Safety pin	0282-1		Foam refill (6 L. bottle, ready to use)	2594-1L
3	Safety pin seal	0285			
4	Pressure gauge	1576			

The spare part at number 1 includes already all others components indicated from 1.1 to 1.6

File name	Type of document	Fire Extinguisher Model	Date	Rele.	Check	Rev.	Pag.
22066-915_Technical manual	Technical manual	22066-915	28/05/2025	S.R		3	3/4

REPRODUCTION IS PROHIBITED

22066-915 : Portable Fire Extinguisher, 6 L Foam

Prerequisite when using the fire extinguisher on lithium batteries

According to tests executed with this fire extinguisher, it's possible to stop the combustion of a lithium-ion battery with a water based fire extinguisher with foam additives. It has been verified that the use of the fire extinguisher allows to lower the temperature and control any re-ignitions of the cells present inside the battery (generated by the chain reaction of the same and due to their shape inside the battery pack).
The battery tested has a voltage of 36 V with a capacity of 20.1 Ah and an anergy value of 750 Wh.
The fire extinguisher tested is therefore effective in containing the flames emanated from a battery with same or inferior characteristics compared to the one tested.

**NOTE: the test was executed on a new battery and so at full efficiency.*

SAFETY WARNING



*The combustion of lithium-ion batteries releases very harmful gases and fumes.
Direct exposure to high concentrations of gases emanating from the combustion of lithium-ion batteries can cause serious damage to health. Lithium-ion batteries can have unpredictable phenomena during fire, such as explosive reactions caused by the pressure of the cells inside the battery pack. It's advisable to use appropriate safety devices.
The use of fire extinguisher is recommended for professional and expert staff.
The use of fire extinguisher by uninformed people can lead to lower results and cause damage to involved people.*

DISCLAIMER

The result of the tests performed refers exclusively to the fire extinguisher model used during the tests themselves. The fast development of lithium-ion batteries and portable fire extinguishers means that the performance achieved during the test phase is not guaranteed when using lithium-ion batteries or shutdown techniques other than those tested. It is not possible to understand where and to what extent these fire extinguishers can be installed due to the outer casing of the lithium-ion battery pack.
The fire extinguishers tested are intended to help contain the principle of fire resulting from the triggering of a lithium-ion battery.

File name	Type of document	Fire Extinguisher Model	Date	Rele.	Check	Rev.	Pag.
22066-915_Technical manual	Technical manual	22066-915	03/10/2024	M.R		2	4/4